


The criteria for E. coli is less than or equal to 100cfu/100ml

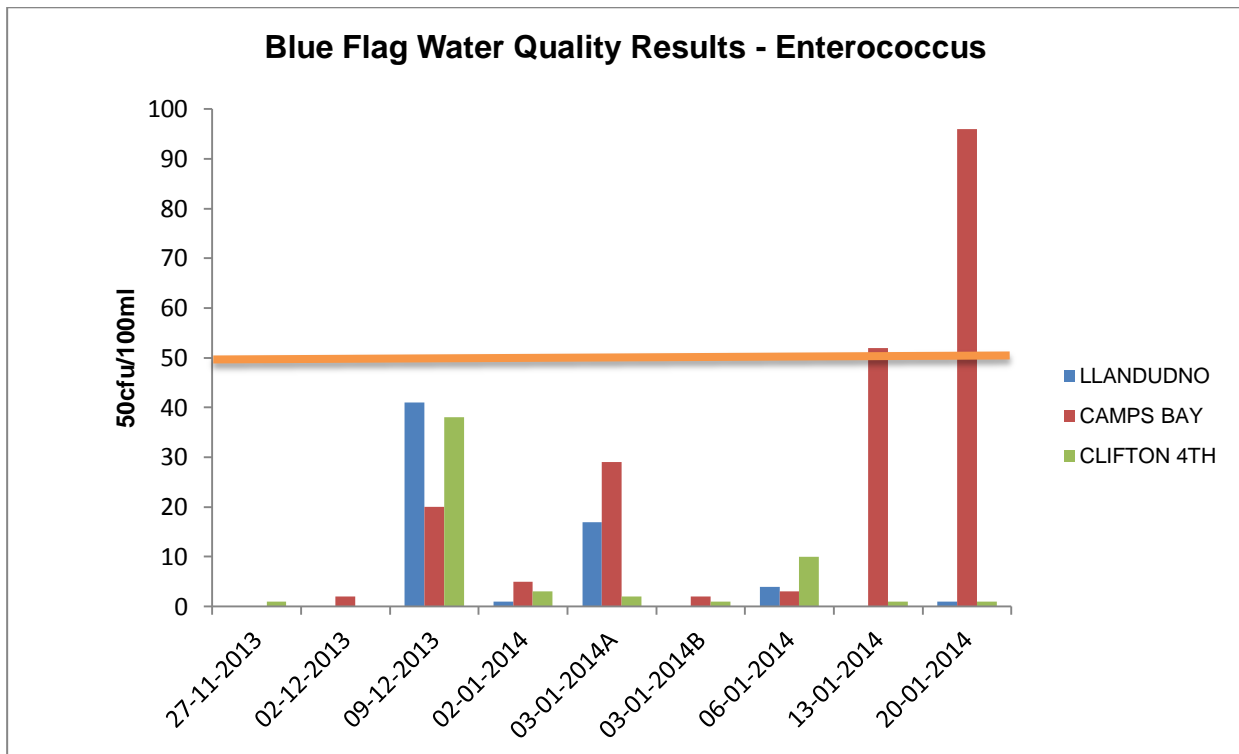

The criteria for Enterococcus is less than or equal to 50cfu/100ml